


消防處
牌照及審批總區

香港九龍尖沙咀東部康莊道1號5樓
消防總部大廈



FIRE SERVICES DEPARTMENT
LICENSING AND CERTIFICATION COMMAND
FIRE SERVICES HEADQUARTERS BUILDING,
5/F, No.1 Hong Chong Road,
Tsim Sha Tsui East, Kowloon,
Hong Kong.

本處檔號 OUR REF.: (4) in FP 206/1237
來函檔號 YOUR REF.: 186/L/05
電子郵件 E-mail : <lcpolice2@hksfd.gov.hk>
圖文傳真 FAX: 852-2367 3631
電話 TEL NO.: 2733 7827

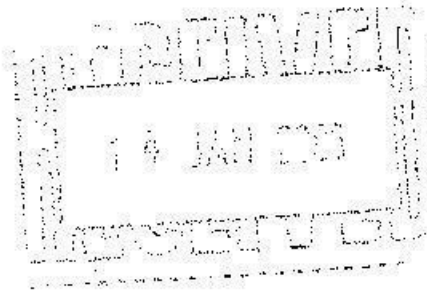

11 January 2006

Dear Sirs,

Acceptance of Fire Detectors and Manual Fire Alarm Button

I refer to my interim reply of 24.10.2005 on the captioned subject.

Please be informed that the following equipment, which has been certified by 「國家消防電子產品質量監督檢驗中心」, is acceptable to this Department:-


- | | | |
|----------------------------|---|---|
| Manufacturer | : | 深圳市奧瑞那光子技術有限公司 |
| 1) Model / Type | : | JTY-GD-OT502 點型光電感烟火災探測器 |
| Testing Standard | : | GB4715-93 |
| Supporting Document | : | 2004年2月3日由「國家消防電子產品質量監督檢驗中心」發出編號20040186的檢驗報告。 |
| 2) Model / Type | : | JTW-ZD-OT303 點型定溫火災探測器 |
| Testing Standard | : | GB4716-93 |
| Supporting Document | : | 2004年2月23日由「國家消防電子產品質量監督檢驗中心」發出編號20040251的檢驗報告。 |
| 3) Model / Type | : | JTW-ZD-OT503 點型定溫火災探測器 |
| Testing Standard | : | GB4716-93 |
| Supporting Document | : | 2004年2月24日由「國家消防電子產品質量監督檢驗中心」發出編號20040259的檢驗報告。 |

- 4) **Model / Type** : JSA-M-OA510 手動火災報警按鈕
- Testing Standard** : GA5-91
- Supporting Document** : 2004年3月2日由「國家消防電子產品質量監督檢驗中心」發出編號20040288的檢驗報告。

Please note that the above acceptance is valid subject to :

- i) all conditions as stipulated in the above-mentioned Test Reports being complied with;
- ii) the installation conforming to FSD Circular Letter No. 1/2002, Rules for Fire Detection and Alarm Systems for Buildings; and
- iii) the components used in the installation being compatible.

Yours faithfully,

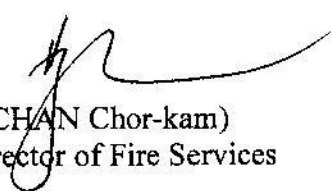
(CHAN Chor-kam)
for Director of Fire Services

CCK/LSM/lcm