


消防處
牌照及審批總區

香港九龍尖沙咀東部康莊道1號5樓
消防總部大廈



FIRE SERVICES DEPARTMENT
LICENSING AND CERTIFICATION COMMAND
FIRE SERVICES HEADQUARTERS BUILDING,
5/F, No.1 Hong Chong Road,
Tsim Sha Tsui East, Kowloon,
Hong Kong.

本處檔號 OUR REF.: (7) in FP 206/1237
來函檔號 YOUR REF.: 069/L/06
電子郵件 E-mail: <lcpolice2@hkfsd.gov.hk>
圖文傳真 FAX: 852-2367 3631
電話 TEL NO.: 2733 7827

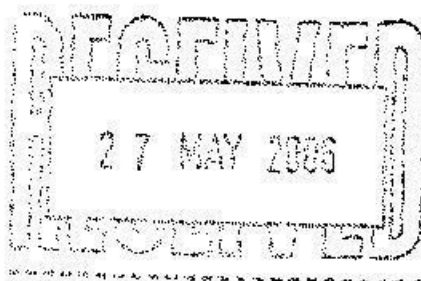

24 May 2006

Dear Sirs,

Acceptance of Fire Alarm Panel and Gas Extinguishing Controller

I refer to my interim reply of 16.3.2006 on the captioned subject.

Please be informed that the following equipment, which has been certified by 「國家消防電子產品質量監督檢驗中心」, is acceptable to this Department:-


- | | | |
|----------------------------|---|--|
| Manufacturer | : | 深圳市奧瑞那光子技術有限公司 |
| 1) Model / Type | : | JB-QG-OZH4800 型火災報警控制器(聯動型) |
| Testing Standards | : | GB4717-93, GB16806-1997 |
| Supporting Document | : | 2001年12月28日由「國家消防電子產品質量監督檢驗中心」發出編號20011710的檢驗報告。 |
| 2) Model / Type | : | JB-QT-OZH4800 型火災報警控制器(聯動型) |
| Testing Standards | : | GB4717-93, GB16806-1997 |
| Supporting Document | : | 2001年12月28日由「國家消防電子產品質量監督檢驗中心」發出編號20011712的檢驗報告。 |
| 3) Model / Type | : | JB-QG-OLK3900 型消防聯動控制設備 |
| Testing Standard | : | GB16806-1997 |
| Supporting Document | : | 2004年3月11日由「國家消防電子產品質量監督檢驗中心」發出編號20040337的檢驗報告。 |

- 4) **Model / Type** : JB-QB-ODM04 型氣體滅火控制器
- Testing Standard** : GB16806-1997
- Supporting Document** : 2004年3月10日由「國家消防電子產品質量監督檢驗中心」發出編號20040335的檢驗報告。

Please note that the above acceptance is valid subject to :

- i) all conditions as stipulated in the above-mentioned test reports being complied with;
- ii) the installation conforming to FSD Circular Letter No. 1/2002, Rules for Fire Detection and Alarm Systems for Buildings, and the current Codes of Practice for Minimum Fire Service Installations and Equipment; and
- iii) the components used in the installation being compatible.

Yours faithfully,

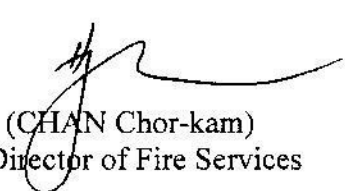
(CHAN Chor-kam)
for Director of Fire Services

CCK/YCO/lcm
REF.: (7) in FP 206/1237